

Structural Calculation Report

PROJECT NAME

One-Bedroom ADU - Spanish
Revival Style

PROJECT ADDRESS Richmond, CA

January 30, 2025

Project: Structural Calculation Report
One-Bedroom ADU – Spanish Revival Style
Richmond, CA

Dear Ms./Mr.,

The following structural design calculation has been prepared for the project above. The scope of work is the design of a one-story, one-bedroom Accessory Dwelling Unit (ADU) – Spanish Revival Style developed for the city of Richmond, California.

By using these standard calculations, the user agrees to release the City of Richmond from any and all claims, liabilities, suits, and demands on account of any injury, damage, or loss to persons or property, including injury or death, or economic losses, arising out of the use of these construction documents. The use of these plans does not eliminate or reduce the user's responsibility to verify any and all information.

These plans are for use only in the City of Richmond, California. It is understood and agreed that this ADU Master Permit Set does not include project observation or review of any contractor's performance or any other construction phaser services, and that such services will be provided for by the person or entity who has received a permit to construct the ADU (Homeowner). Any use of these documents, or modifications thereto, by the Homeowner, contractors, builders, or others (User), is performed at their own risk. The User assumes all responsibility for the use and interpretation of these documents and for construction observation and the User waives, to the fullest extent permitted by law, any claims or causes of action of any nature against the architect, its officers, directors, employees, agents, and subconsultants (collectively, Consultant), which may arise out of or that may be in any way connected thereto. In addition, the User agrees, to the fullest extent permitted by law, to defend, indemnify and hold harmless that Consultant against any and all claims, causes of action, lawsuits, damages, liabilities or costs, including reasonable attorneys' fees and defense costs (Claims), arising out of or in any way connected with the performance of such services by other persons or entities and from any and all Claims arising from use, modifications, clarifications, interpretations, adjustments, or changes made to these documents to reflect changed field or other conditions.

The plan set does not include a foundation system. Site specific foundation details are required for ADUs in the city of Richmond. The applicant must hire a general contractor or structural engineer to prepare site specific foundation details and include foundation details with the application for approval by the city of Richmond. Note this includes details and design for the hold down anchorage and bearing posts noted on the S2.1 plan.

Design criteria:

Building Code: CBC 2022

BASIS OF DESIGN (BOD)

Project Name: One-Bedroom ADU - Spanish Revival Style

Date: Jan. 30, 2025

Project Address: Richmond, California

The following structural design criteria has been prepared for the project above. The scope of work is the design of the one-story, one-bedroom accessory dwelling unit (ADU) – Spanish Revival Style for the city of Richmond, California.

Design Criteria:

Building Code: 2022 California Building Code (CBC) with local amendments.

Construction Type: Type V-B [per Arch and CBC Ch. 6]

Occupancy Type: R-2 [per Arch and CBC Ch. 3]

Risk Category: II [CBC Table 1604.5]

Gravity System:

Roof Framing: Pitched roof: 2x8 rafters at 24" o.c. with 15/32" plywood unblocked

Wall Framing: 2x6 D.F. No 2. studs at 16" o.c. typical.

Lateral System:

The lateral system will consist of plywood wood shear wall with a hold down at each end of the wall.

Analysis Method:

Lateral Analysis: Equivalent Force Procedure or Spectral Response is used for seismic force.

Diaphragm is designed as flexible.

Seismic Design Criteria [from USGS Hazard Maps, ASCE 7-16]

This project provides a calculation package and plans for any home owner in the city of Richmond, California to build this particular accessory dwelling unit on their land. To allow for versatility in building locations within the city, the seismic parameters of 6 locations were investigated and the highest values were used for this project design.

Mapped MCE_R Spectral Response (short period), S_s : 2.272 g

Mapped MCE_R Spectral Response (one second), S_1 : 0.877 g

Design Spectral Response (short period), S_{DS} : 1.818 g

Design Spectral Response (one second), S_{D1} : 0.994 g

Seismic Design Category: E

Seismic Importance Factor, I_e : 1 [ASCE 7-16 Table 1.5-2]

Wind Design Criteria:

Basic Wind Speed: 95 MPH

Exposure Category: C

Other Design Criteria:

Rain Intensity: 1.13 in/hr

Live Loads:

Roof: 20 PSF

Special Conditions:

Solar panel weight is accounted in the total loads design.

Wood:

All wood shall conform to the following:

| Wood | |
|--|------|
| Joists and rafters | NO.1 |
| Posts, beams and headers | NO.1 |
| Studs, blockings, light framing and misc. | NO.2 |
| Wall plates | NO.2 |
| Wood sill (P.T.) | NO.2 |
| Pressure treated (P.T.) Joist, beams and posts | NO.2 |

| Engineered Wood (WEYERHAEUSER) | |
|------------------------------------|--------|
| LVL MICRO-LAMS | 2.2E |
| LSL TIMBER STRAND | 1.55E |
| PSL PARALLEL STRAND LUMBER (BEAMS) | 2.2E |
| PSL PARALLEL STRAND LUMBER (POSTS) | 1.8E |
| I JOIST PER PLAN | U.O.N. |


Table of Contents

| | |
|---|------|
| COVER SHEET | |
| BASIS OF DESIGN | |
| TABLE OF CONTENTS | |
| | Page |
| Vertical Load Table | 1 |
| Vertical Design | |
| Roof Framing Key Plan | 2 |
| Beam Diagrams | 3 |
| Beam Design Calculation..... | 4 |
| Column Design Calculation | 7 |
| Wall Stud Calculations..... | 8 |
| Lateral Design | |
| Seismic Parameters & Location Map | 12 |
| Seismic Design Criteria | 13 |
| Seismic Weight..... | 15 |
| Seismic Base Shear | 16 |
| Seismic Key Plan | 19 |
| Shear wall Design Calculations..... | 20 |
| Diaphragm Design Calculations..... | 26 |
| Appendix A: Seismic Parameters | |
| Seismic Parameters | 28 |

| | | | |
|---------------------|---|-------------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUMBER: | 3759 |
| DESCRIPTION: | DESIGN OF ADU | DATE: | 2025-01-30 |
| VERTICAL LOAD TABLE | | BY: | |

| | | |
|-------------------------------|-----------|-------------|
| ROOF PITCH | | 5:12 slope |
| ROOF LEVEL | | SOLAR |
| COMPOSITE SHINGLE | | 2.5 |
| SOLAR PANELS | | 5.0 |
| 15/32" PLYWOOD (OSB) | | 1.8 |
| INSULATION | | 1.0 |
| RAFTERS 2 x 8 @ 24" O.C. | | 1.3 |
| 2X8 @ 16" O.C. CEILING JOISTS | | 1.9 |
| 5/8" GYPBOARD | | 2.8 |
| MISCELLANEOUS | | 1.2 |
| TOTAL | DL (psf) | 17.5 |
| ADJUSTED TOTAL | DL (psf) | 19.0 |
| TOTAL | RLL (psf) | 20 |

| WALLS | | EXTERIOR | INTERIOR |
|----------------------|----------|-------------|-------------|
| STUCCO | | 10.0 | - |
| PLASTER | | - | 2.0 |
| 15/32" PLYWOOD (OSB) | | 1.8 | - |
| STUDS 2X6 @ 16" O.C. | | 1.4 | 1.4 |
| INSULATION | | 1.0 | 1.0 |
| 5/8" GYPBOARD | | 2.8 | 5.6 |
| MISCELLANEOUS | | 1.0 | 1.0 |
| TOTAL | DL (psf) | 18.0 | 11.0 |

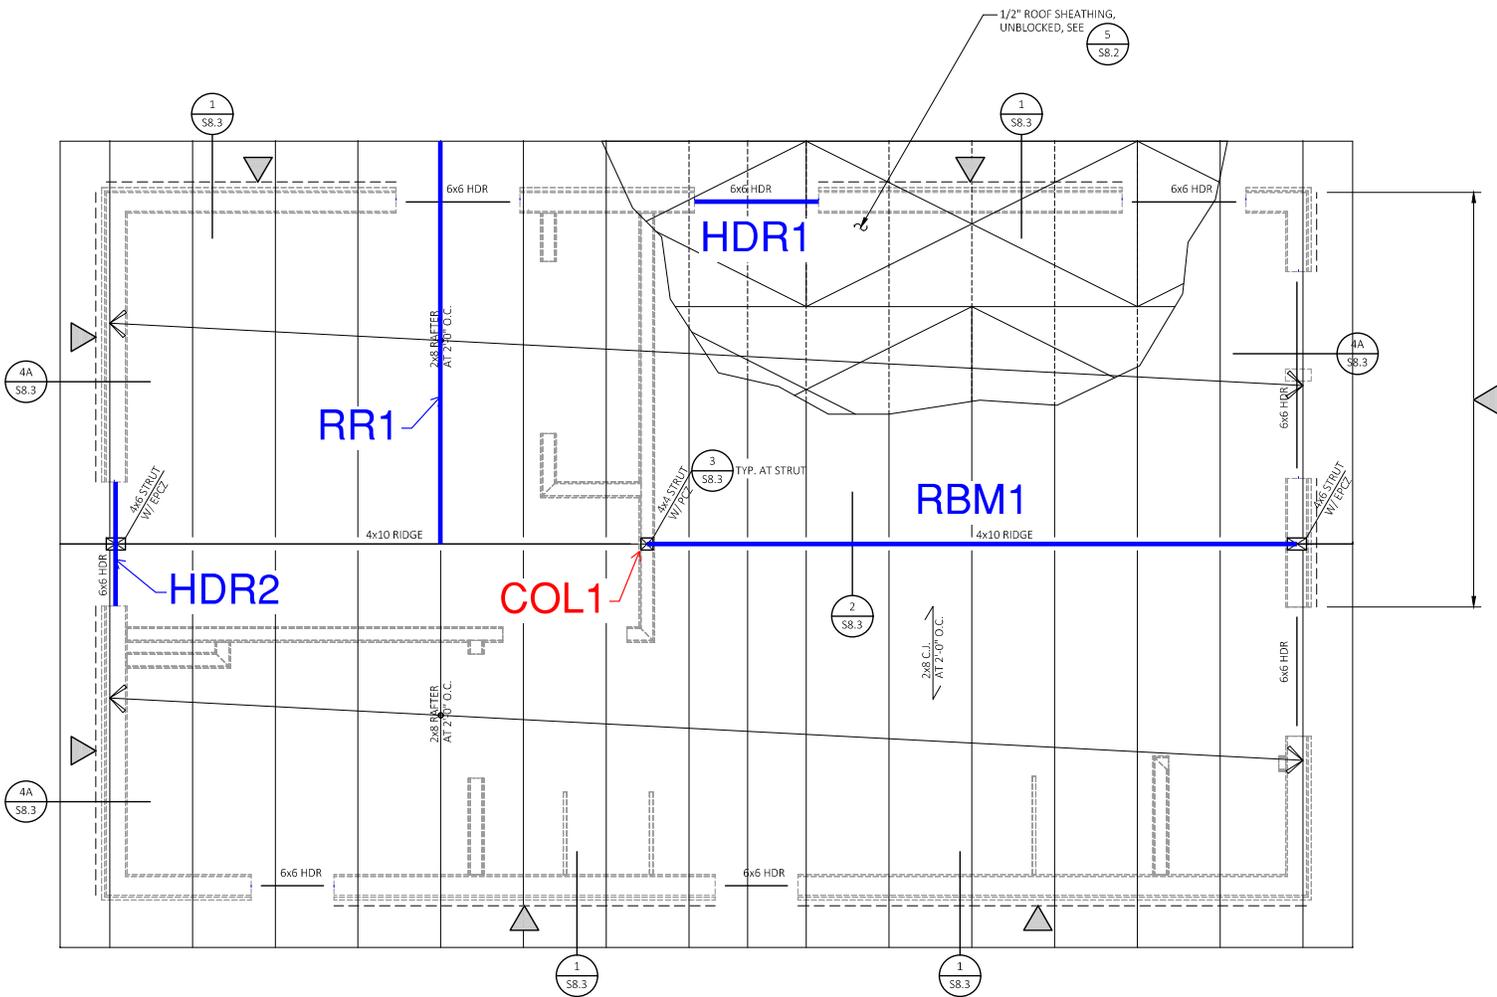

ROOF FRAMING KEY PLAN

Note: Key plan is not representative of structural framing and is only to indicate design beam locations

| | | | |
|-----------------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | Beam Diagrams | DATE: | 2025-01-30 |
| VERTICAL CALCULATIONS | | BY: | |

BEAM DIAGRAMS

ROOF LEVEL

RR1

$W_{DL} = 19.0 \text{ psf} \times 2.00 \text{ ft} = 0.038 \text{ klf}$ Roof
 $W_{RLL} = 20.0 \text{ psf} \times 2.00 \text{ ft} = 0.040 \text{ klf}$ Roof
 $L_1 = 8.25 \text{ ft}$ $L_2 = 1.50 \text{ ft}$

RBM1

$W_{DL} = 19.0 \text{ psf} \times 8.25 \text{ ft} = 0.157 \text{ klf}$ Roof
 $W_{RLL} = 20.0 \text{ psf} \times 8.25 \text{ ft} = 0.165 \text{ klf}$ Roof
 $L = 15.75 \text{ ft}$

HDR1

$W_{DL} = 19.0 \text{ psf} \times 5.63 \text{ ft} = 0.107 \text{ klf}$ Roof
 $W_{RLL} = 20.0 \text{ psf} \times 5.63 \text{ ft} = 0.113 \text{ klf}$ Roof
 $L = 3.00 \text{ ft}$

HDR2

$W_{1DL} = 19.0 \text{ psf} \times 3.00 \text{ ft} = 0.057 \text{ klf}$ Roof
 $W_{RLL} = 20.0 \text{ psf} \times 3.00 \text{ ft} = 0.060 \text{ klf}$ Roof
 $P_{1DL} = 1.340 \text{ kip}$ $a_1 = 1.50 \text{ ft}$ RBM1 SIM.
 $P_{1RLL} = 1.300 \text{ kip}$ $a_1 = 1.50 \text{ ft}$ RBM1 SIM.
 $L = 3.00 \text{ ft}$

Multiple Simple Beam

Project File: 3759F_Framing Design.ec6

LIC# : KW-06014728, Build:20.24.12.02

(c) ENERCALC, LLC 1982-2025

Description :

Wood Beam Design : RR1-No. 1

Calculations per NDS 2018, IBC 2021

BEAM Size : 2x8, Sawn, Fully Braced

Using Allowable Stress Design with IBC 2021 Load Combinations, Major Axis Bending

Wood Species : Douglas Fir-Larch

Wood Grade : No.1

| | | | | | | | | | |
|--------------|----------|-----------|----------|----|---------|---------------|----------|---------|-----------|
| Fb - Tension | 1000 psi | Fc - Prll | 1500 psi | Fv | 180 psi | Ebend- xx | 1700 ksi | Density | 31.21 pcf |
| Fb - Compr | 1000 psi | Fc - Perp | 625 psi | Ft | 675 psi | Eminbend - xx | 620 ksi | | |

Applied Loads

Beam self weight calculated and added to loads
 Unif Load: D = 0.0190, Lr = 0.020 k/ft, Trib= 2.0 ft

Design Summary

Max fb/Fb Ratio = **0.389** : 1
 fb : Actual : 583.72 psi at 4.001 ft in Span # 1
 Fb : Allowable : 1,500.00 psi
 Load Comb : +D+Lr+H
 Max fv/FvRatio = **0.181** : 1
 fv : Actual : 40.83 psi at 7.673 ft in Span # 1
 Fv : Allowable : 225.00 psi
 Load Comb : +D+Lr+H



| | | | | | | | |
|-------------------|------|------|---|---|---|---|---|
| Max Reactions (k) | D | Lr | L | S | W | E | H |
| Left Support | 0.16 | 0.16 | | | | | |
| Right Support | 0.23 | 0.23 | | | | | |

Max Deflections

| | | | |
|--------------------|-------------|----------------|-------------|
| Transient Downward | 0.048 in | Total Downward | 0.096 in |
| Ratio | 2071 | Ratio | 1031 |
| | LC: Lr Only | | LC: +D+Lr+H |
| Transient Upward | -0.025 in | Total Upward | -0.051 in |
| Ratio | 1414 | Ratio | 702 |
| | LC: Lr Only | | LC: +D+Lr+H |

Wood Beam Design : RBM1

Calculations per NDS 2018, IBC 2021

BEAM Size : 6x12, Sawn, Fully Braced

Using Allowable Stress Design with IBC 2021 Load Combinations, Major Axis Bending

Wood Species : Douglas Fir-Larch

Wood Grade : No.1

| | | | | | | | | | |
|--------------|-------------|-----------|-------------|----|-----------|---------------|-------------|---------|------------|
| Fb - Tension | 1,000.0 psi | Fc - Prll | 1,500.0 psi | Fv | 180.0 psi | Ebend- xx | 1,700.0 ksi | Density | 31.210 pcf |
| Fb - Compr | 1,000.0 psi | Fc - Perp | 625.0 psi | Ft | 675.0 psi | Eminbend - xx | 620.0 ksi | | |

Applied Loads

Beam self weight calculated and added to loads
 Unif Load: D = 0.0190, Lr = 0.020 k/ft, Trib= 8.250 ft

Design Summary

Max fb/Fb Ratio = **0.824** : 1
 fb : Actual : 1,029.64 psi at 7.875 ft in Span # 1
 Fb : Allowable : 1,250.00 psi
 Load Comb : +D+Lr+H
 Max fv/FvRatio = **0.245** : 1
 fv : Actual : 55.13 psi at 0.000 ft in Span # 1
 Fv : Allowable : 225.00 psi
 Load Comb : +D+Lr+H



| | | | | | | | |
|-------------------|------|------|---|---|---|---|---|
| Max Reactions (k) | D | Lr | L | S | W | E | H |
| Left Support | 1.34 | 1.30 | | | | | |
| Right Support | 1.34 | 1.30 | | | | | |

Max Deflections

| | | | |
|--------------------|-------------|----------------|-------------|
| Transient Downward | 0.194 in | Total Downward | 0.394 in |
| Ratio | 975 | Ratio | 479 |
| | LC: Lr Only | | LC: +D+Lr+H |
| Transient Upward | 0.000 in | Total Upward | 0.000 in |
| Ratio | 9999 | Ratio | 9999 |
| | LC: | | LC: |

Multiple Simple Beam

Project File: 3759F_Framing Design.ec6

LIC#: KW-06014728, Build:20.24.12.02

(c) ENERCALC, LLC 1982-2025

Wood Beam Design : HDR1

Calculations per NDS 2018, IBC 2021

BEAM Size : **6x6, Sawn, Fully Unbraced**

Using Allowable Stress Design with IBC 2021 Load Combinations, Major Axis Bending

Wood Species : Douglas Fir-Larch

Wood Grade : No.1

Fb - Tension 1,000.0 psi Fc - Prll 1,500.0 psi Fv 180.0 psi Ebend- xx 1,700.0 ksi Density 31.210 pcf
 Fb - Compr 1,000.0 psi Fc - Perp 625.0 psi Ft 675.0 psi Eminbend - xx 620.0 ksi

Applied Loads

Beam self weight calculated and added to loads

Unif Load: D = 0.0190, Lr = 0.020 k/ft, Trib= 5.630 ft

Design Summary

Max fb/Fb Ratio = **0.088** : 1
 fb : Actual : 110.09 psi at 1.500 ft in Span # 1
 Fb : Allowable : 1,250.00 psi
 Load Comb : +D+Lr+H

Max fv/FvRatio = **0.052** : 1
 fv : Actual : 11.77 psi at 2.550 ft in Span # 1
 Fv : Allowable : 225.00 psi
 Load Comb : +D+Lr+H

Max Reactions (k) D Lr L S W E H
 Left Support 0.17 0.17
 Right Support 0.17 0.17



Max Deflections

| | | | |
|--------------------|----------|----------------|----------|
| Transient Downward | 0.002 in | Total Downward | 0.003 in |
| Ratio | 9999 | Ratio | 9999 |
| LC: Lr Only | | LC: +D+Lr+H | |
| Transient Upward | 0.000 in | Total Upward | 0.000 in |
| Ratio | 9999 | Ratio | 9999 |
| LC: | | LC: | |

Wood Beam Design : HDR2

Calculations per NDS 2018, IBC 2021

BEAM Size : **6x6, Sawn, Fully Unbraced**

Using Allowable Stress Design with IBC 2021 Load Combinations, Major Axis Bending

Wood Species : Douglas Fir-Larch

Wood Grade : No.1

Fb - Tension 1,000.0 psi Fc - Prll 1,500.0 psi Fv 180.0 psi Ebend- xx 1,700.0 ksi Density 31.210 pcf
 Fb - Compr 1,000.0 psi Fc - Perp 625.0 psi Ft 675.0 psi Eminbend - xx 620.0 ksi

Applied Loads

Beam self weight calculated and added to loads

Unif Load: D = 0.0190, Lr = 0.020 k/ft, Trib= 3.0 ft


1Point: D = 1.340, Lr = 1.30 k @ 1.50 ft

Design Summary

Max fb/Fb Ratio = **0.734** : 1
 fb : Actual : 917.01 psi at 1.500 ft in Span # 1
 Fb : Allowable : 1,250.00 psi
 Load Comb : +D+Lr+H

Max fv/FvRatio = **0.320** : 1
 fv : Actual : 71.89 psi at 2.550 ft in Span # 1
 Fv : Allowable : 225.00 psi
 Load Comb : +D+Lr+H

Max Reactions (k) D Lr L S W E H
 Left Support 0.77 0.74
 Right Support 0.77 0.74

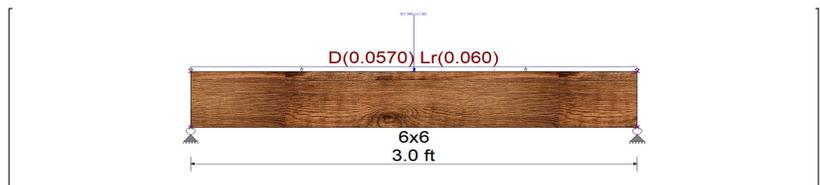

Max Deflections

| | | | |
|--------------------|----------|----------------|----------|
| Transient Downward | 0.011 in | Total Downward | 0.022 in |
| Ratio | 3382 | Ratio | 1663 |
| LC: Lr Only | | LC: +D+Lr+H | |
| Transient Upward | 0.000 in | Total Upward | 0.000 in |
| Ratio | 9999 | Ratio | 9999 |
| LC: | | LC: | |

Multiple Simple Beam

Project File: 3759F_Framing Design.ec6

LIC# : KW-06014728, Build:20.24.12.02

(c) ENERCALC, LLC 1982-2025

Wood Beam Design : RR1-No. 2

Calculations per NDS 2018, IBC 2021

BEAM Size : **2x8, Sawn, Fully Braced**

Using Allowable Stress Design with IBC 2021 Load Combinations, Major Axis Bending

Wood Species : Douglas Fir-Larch

Wood Grade : No.2

| | | | | | | | | | |
|--------------|---------|-----------|----------|----|---------|---------------|----------|---------|-----------|
| Fb - Tension | 900 psi | Fc - Prll | 1350 psi | Fv | 180 psi | Ebend- xx | 1600 ksi | Density | 31.21 pcf |
| Fb - Compr | 900 psi | Fc - Perp | 625 psi | Ft | 575 psi | Eminbend - xx | 580 ksi | | |

Applied Loads

Beam self weight calculated and added to loads

Unif Load: D = 0.0190, Lr = 0.020 k/ft, Trib= 2.0 ft

Design Summary

Max fb/Fb Ratio = **0.432** : 1
 fb : Actual : 583.72 psi at 4.001 ft in Span # 1
 Fb : Allowable : 1,350.00 psi
 Load Comb : +D+Lr+H

Max fv/FvRatio = **0.181** : 1
 fv : Actual : 40.83 psi at 7.673 ft in Span # 1
 Fv : Allowable : 225.00 psi
 Load Comb : +D+Lr+H

| | | | | | | | |
|-------------------|------|------|---|---|---|---|---|
| Max Reactions (k) | D | Lr | L | S | W | E | H |
| Left Support | 0.16 | 0.16 | | | | | |
| Right Support | 0.23 | 0.23 | | | | | |



Max Deflections

| | | | |
|--------------------|-------------|----------------|-------------|
| Transient Downward | 0.051 in | Total Downward | 0.102 in |
| Ratio | 1949 | Ratio | 970 |
| | LC: Lr Only | | LC: +D+Lr+H |
| Transient Upward | -0.027 in | Total Upward | -0.054 in |
| Ratio | 1330 | Ratio | 662 |
| | LC: Lr Only | | LC: +D+Lr+H |

| | | | |
|-----------------------|---|-------------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUMBER: | 3759 |
| DESCRIPTION: | Column Design and Capacity | DATE: | 2025-01-30 |
| VERTICAL CALCULATIONS | | BY: | |

POST DESIGN

| ASD LOAD COMBINATIONS | S_{DS} | | 1.818 g | | Ω | | 2.5 | |
|-----------------------|----------|-----|---------|------|----------|-----|-------|---|
| 1) | 1.000 | D + | 1.000 | Lr + | 0.000 | L + | 0.000 | E |
| 2) | 1.000 | D + | 0.000 | Lr + | 1.000 | L + | 0.000 | E |
| 3) | 1.000 | D + | 0.750 | Lr + | 0.750 | L + | 0.000 | E |
| 4) | 1.255 | D + | 0.000 | Lr + | 0.000 | L + | 1.750 | E |
| 5) | 1.191 | D + | 0.000 | Lr + | 0.750 | L + | 1.313 | E |
| 6) | 0.345 | D + | 0.000 | Lr + | 0.000 | L + | 1.750 | E |


Wall Height = 9.0 ft

1ST FLOOR LEVEL

| ID | BEARING MEMBERS | D (k) | Lr (k) | L (k) | E (k) | D,L,Lr | D, L,Lr,E | D,L,Lr | D, L,Lr,E | Hardware | D/C | wall size |
|-------|-----------------|-------|--------|-------|-------|--------|-----------|--------|-----------|----------|------|-----------|
| COL 1 | (2) - RBM1 | 2.680 | 2.600 | 0.000 | 0.000 | 5.280 | | 4x4 | | Y | 0.82 | 2x4 |

Column Capacity

| Axial | Direction | 100% | Seismic | Post Base |
|-------|-----------|---------|---------|-----------|
| 4x4 | B | 6.44 K | 6.74 K | 7.66 K |
| 4x6 B | B | 10.13 K | 10.59 K | 12.03 K |
| 4x8 | B | 13.35 K | 13.96 K | 15.86 K |
| 4x10 | B | 17.03 K | 17.81 K | 20.23 K |
| 4x12 | B | 20.71 K | 21.66 K | 24.61 K |
| 4x6 A | A | 19.53 K | 23.09 K | 12.03 K |
| 6x6 | B | 23.68 K | 30.43 K | 18.91 K |
| 6x8 | B | 32.28 K | 41.49 K | 25.78 K |
| 6x10 | B | 40.89 K | 52.55 K | 32.66 K |

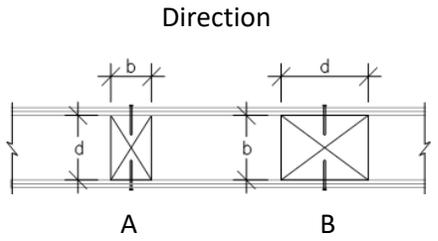

| | | | |
|-----------------------|---|-------------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUMBER: | 3759 |
| DESCRIPTION: | Stud Wall Calculation | DATE: | 2025-01-30 |
| VERTICAL CALCULATIONS | | BY: | |

STUD CALCULATION: LINE A (SEE SEISMIC KP)
1st STORY LEVEL
9 FT STUDS

| DATA | | Wood Type: | | Adjustment Factors: | |
|------------------------------|-------|-----------------|-------------------|---------------------|------|
| Member: | | Species | Douglas Fir-Larch | C_M | 1.00 |
| Size | 2x6 | Class | 2in-4in thick | C_t | 1.00 |
| Stud Spacing | 16 in | Grade | No. 2 | C_L | 1.00 |
| L_e (ft) | 9.00 | F_b (psi) | 900 | C_{D1} | 1.25 |
| L_u (ft) | 9.00 | F_c (psi) | 1350 | C_{D2} | 1.60 |
| b (in) | 1.50 | F_{cL} (psi) | 625 | C_{D3} | 1.00 |
| d (in) | 5.50 | E_{min} (psi) | 580000 | C_i | 1.00 |
| A (in ²) | 8.25 | c | 0.80 | C_F | 1.00 |
| S_{xx} (in. ³) | 7.56 | K_{cE} | 0.30 | C_b | 1.00 |
| | | | | C_T | 1.00 |
| | | | | C_r | 1.00 |

LOADING

| Description | DL (psf) | LR (psf) | LL (psf) | H/TW (ft) | w_{DL} (plf) | w_{LR} (plf) | w_{LL} (plf) |
|--------------|----------|----------|----------|-----------|----------------|----------------|----------------|
| Roof | 19 | 20 | 0 | 6 | 107 | 113 | 0 |
| Wall Level 1 | 18 | 0 | 0 | 9 | 162 | 0 | 0 |
| - | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| - | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| - | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| - | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| - | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| - | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| - | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Total | | | | | 269 | 113 | 0 |

Lateral Load:

| | | | |
|------|--------|------------|---------|
| WIND | 30 psf | w_{WIND} | 40 plf |
| LL | 0 psf | w_{LL} | 0.0 plf |

GRAVITY + LATERAL

| ASD Load Combination: | Gravity (plf) | Lat. (plf) |
|---|---------------|------------|
| LC2. $w_{DL} + w_{LL} =$ | 268.9 | 0.0 |
| LC3. $w_{DL} + w_{Lr} =$ | 381.4 | 0.0 |
| LC4. $w_{DL} + 0.75*w_{LL} + 0.75*w_{Lr} =$ | 353.3 | 0.0 |
| LC5. $w_{DL} + 0.6*w_{WIND} =$ | 268.9 | 24.0 |
| LC6a. $w_{DL} + 0.75*w_{LL} + 0.75*w_{Lr} + 0.75(0.6*w_{WIND}) =$ | 353.3 | 18.0 |

| | | | |
|-----------------------|---|-------------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUMBER: | 3759 |
| DESCRIPTION: | Stud Wall Calculation | DATE: | 2025-01-30 |
| VERTICAL CALCULATIONS | | BY: | |

Load combination 2

LC2. $w_{DL} + w_{LL}$

$p = 358.5 \text{ lb}$
 $f_c = p / A = 43.5 \text{ psi}$

Column Capacity of Stud:

$(L_e/d)_x^2 = 354.12$
 $E'_{min} = E_{min} C_M C_t C_T C_i = 580000 \text{ psi}$
 $F_{cE} = 0.822 E'_{min} / (L_e/d)_x^2 = 1346 \text{ psi}$
 $F^*_c = F_c C_{D3} C_M C_t C_F C_i = 1350 \text{ psi}$
 $X = [1 + F_{cE} / F^*_c] / 2c = 1.25$
 $C_P = X - [X^2 - ((F_{cE} / F^*_c) / c)]^{1/2} = 0.69$
 $F'_c = F_c C_{D3} C_M C_t C_F C_i C_P = 931.5 \text{ psi}$
 Check if $F'_c > f_c$ D/C = 0.05

Bearing Check:

$F'_{cL} = F_{cL} C_M C_T C_b = 625 \text{ psi}$
 $f'_{cL} = p/A = 43.45 \text{ psi}$
 Check if $F'_{cL} > f'_{cL}$ D/C = 0.07

Bending:

$w_{LAT} = 0.00 \text{ plf}$
 $M = (w \times L_u^2) / 8 = 0.0 \text{ in-lb}$
 $f_b = M / S_{xx} = 0 \text{ psi}$
 $F'_b = F_b C_{D3} C_M C_t C_L C_F C_r C_i = 900 \text{ psi}$
 Check if $F'_b > f_b$ D/C = 0.00

Combined Stresses:

$(f_c / F'_c)^2 + (f_{bx} / F'_{bx}) * (1 / (1 - f_c / F_{cEx})) = 2.18E-03$
 Check if ≤ 1.0 D/C = 0.00

**Use 2x6 Douglas Fir-Larch No. 2 Studs at 16 o.c.
at the 1st STORY LEVEL**

Load combination 3

LC3. $w_{DL} + w_{Lr}$

$p = 508.50 \text{ lb}$
 $f_c = p / A = 61.64 \text{ psi}$

Column Capacity of Stud:

$(L_e/d)_x^2 = 354.12$
 $E'_{min} = E_{min} C_M C_t C_T C_i = 580000 \text{ psi}$
 $F_{cE} = 0.822 E'_{min} / (L_e/d)_x^2 = 1346 \text{ psi}$
 $F^*_c = F_c C_{D1} C_M C_t C_F C_i = 1688 \text{ psi}$
 $X = [1 + F_{cE} / F^*_c] / 2c = 1.12$
 $C_P = X - [X^2 - ((F_{cE} / F^*_c) / c)]^{1/2} = 0.61$
 $F'_c = F_c C_{D1} C_M C_t C_F C_i C_P = 1027.0 \text{ psi}$
 Check if $F'_c > f_c$ D/C = 0.06

Bearing Check:

$F'_{cL} = F_{cL} C_M C_T C_b = 625 \text{ psi}$
 $f'_{cL} = p/A = 61.64 \text{ psi}$
 Check if $F'_{cL} > f'_{cL}$ D/C = 0.10

Bending:

$w_{LAT} = 0.00 \text{ plf}$
 $M = (w \times L_u^2) / 8 = 0.0 \text{ in-lb}$
 $f_b = M / S_{xx} = 0 \text{ psi}$
 $F'_b = F_b C_{D1} C_M C_t C_L C_F C_r C_i = 1125 \text{ psi}$
 Check if $F'_b > f_b$ D/C = 0.00

Combined Stresses:

$(f_c / F'_c)^2 + (f_{bx} / F'_{bx}) * (1 / (1 - f_c / F_{cEx})) = 3.60E-03$
 Check if ≤ 1.0 D/C = 0.00

**Use 2x6 Douglas Fir-Larch No. 2 Studs at 16 o.c.
at the 1st STORY LEVEL**

| | | | |
|-----------------------|---|-------------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUMBER: | 3759 |
| DESCRIPTION: | Stud Wall Calculation | DATE: | 2025-01-30 |
| VERTICAL CALCULATIONS | | BY: | |

Load combination 4

LC4: $w_{DL} + 0.75*w_{LL} + 0.75*w_{Lr}$

$p = 471.00 \text{ lb}$
 $f_c = p / A = 57.09 \text{ psi}$

Column Capacity of Stud:

$(L_e/d)_x^2 = 354.12$
 $E'_{min} = E_{min} C_M C_t C_T C_i = 580000 \text{ psi}$
 $F_{cE} = 0.822 E'_{min} / (L_e/d)_x^2 = 1346 \text{ psi}$
 $F^*_c = F_c C_{D1} C_M C_t C_F C_i = 1688 \text{ psi}$
 $X = [1 + F_{cE} / F^*_c] / 2c = 1.12$
 $C_P = X - [X^2 - ((F_{cE} / F^*_c) / c)]^{1/2} = 0.61$
 $F'_c = F_c C_{D1} C_M C_t C_F C_i C_P = 1027.0 \text{ psi}$
 Check if $F'_c > f_c$ D/C = 0.06

Bearing Check:

$F'_{cL} = F_{cL} C_M C_T C_b = 625 \text{ psi}$
 $f'_{cL} = p/A = 57.09 \text{ psi}$
 Check if $F'_{cL} > f'_{cL}$ D/C = 0.09

Bending:

$w_{LAT} = 0.00 \text{ plf}$
 $M = (w \times L_u^2) / 8 = 0.0 \text{ in-lb}$
 $f_b = M / S_{xx} = 0 \text{ psi}$
 $F'_b = F_b C_{D2} C_M C_t C_L C_F C_r C_i = 1125 \text{ psi}$
 Check if $F'_b > f_b$ D/C = 0.00

Combined Stresses:

$(f_c / F'_c)^2 + (f_{bx} / F'_{bx}) * (1 / (1 - f_c / F_{cEX})) = 3.09E-03$
 Check if ≤ 1.0 D/C = 0.00

Use 2x6 Douglas Fir-Larch No. 2 Studs at 16 o.c. at the 1st STORY LEVEL

Load combination 5

LC5: $w_{DL} + 0.6*w_{WIND}$

$p = 358.50 \text{ lb}$
 $f_c = p / A = 43.45 \text{ psi}$

Column Capacity of Stud:

$(L_e/d)_x^2 = 354.12$
 $E'_{min} = E_{min} C_M C_t C_T C_i = 580000 \text{ psi}$
 $F_{cE} = 0.822 E'_{min} / (L_e/d)_x^2 = 1346 \text{ psi}$
 $F^*_c = F_c C_{D2} C_M C_t C_F C_i = 2160 \text{ psi}$
 $X = [1 + F_{cE} / F^*_c] / 2c = 1.01$
 $C_P = X - [X^2 - ((F_{cE} / F^*_c) / c)]^{1/2} = 0.51$
 $F'_c = F_c C_{D2} C_M C_t C_F C_i C_P = 1111.0 \text{ psi}$
 Check if $F'_c > f_c$ D/C = 0.04

Bearing Check:

$F'_{cL} = F_{cL} C_M C_T C_b = 625 \text{ psi}$
 $f'_{cL} = p/A = 43.45 \text{ psi}$
 Check if $F'_{cL} > f'_{cL}$ D/C = 0.07

Bending:

$w_{LAT} = 24.00 \text{ plf}$
 $M = (w \times L_u^2) / 8 = 2678.1 \text{ in-lb}$
 $f_b = M / S_{xx} = 354 \text{ psi}$
 $F'_b = F_b C_{D2} C_M C_t C_L C_F C_r C_i = 1440 \text{ psi}$
 Check if $F'_b > f_b$ D/C = 0.25

Combined Stresses:

$(f_c / F'_c)^2 + (f_{bx} / F'_{bx}) * (1 / (1 - f_c / F_{cEX})) = 0.26$
 Check if ≤ 1.0 D/C = 0.26

Use 2x6 Douglas Fir-Larch No. 2 Studs at 16 o.c. at the 1st STORY LEVEL

| | | | |
|-----------------------|---|-------------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUMBER: | 3759 |
| DESCRIPTION: | Stud Wall Calculation | DATE: | 2025-01-30 |
| VERTICAL CALCULATIONS | | BY: | |

Load combination 6

$$LC6a. w_{DL} + 0.75*w_{LL} + 0.75*w_{Lr} + 0.75(0.6*w_{WIND})$$

$$p = 471.00 \text{ lb}$$

$$f_c = p / A = 57.09 \text{ psi}$$

Column Capacity of Stud:

$$(L_e/d)_x^2 = 354.12$$

$$E'_{min} = E_{min} C_M C_t C_T C_i = 580000 \text{ psi}$$

$$F_{cE} = 0.822 E'_{min} / ((L_e/d)_x)^2 = 1346 \text{ psi}$$

$$F'_c = F_c C_{D2} C_M C_t C_F C_i = 2160 \text{ psi}$$

$$X = [1 + F_{cE} / F'_c] / 2c = 1.01$$

$$C_P = X - [X^2 - ((F_{cE} / F'_c) / c)]^{1/2} = 0.51$$

$$F'_c = F_c C_{D2} C_M C_t C_F C_i C_P = 1111.0 \text{ psi}$$

Check if $F'_c > f_c$ D/C = 0.05

Bearing Check:

$$F'_{cL} = F_{cL} C_M C_T C_b = 625 \text{ psi}$$

$$f'_{cL} = p/A = 57.09 \text{ psi}$$

Check if $F'_{cL} > f'_{cL}$ D/C = 0.09

Bending:

$$w_{LAT} = 18.00 \text{ plf}$$

$$M = (w \times L_u^2) / 8 = 2008.5 \text{ in-lb}$$

$$f_b = M / S_{xx} = 266 \text{ psi}$$

$$F'_b = F_b C_{D2} C_M C_t C_L C_F C_r C_i = 1440 \text{ psi}$$


Check if $F'_b > f_b$ D/C = 0.18

Combined Stresses:

$$(f_c / F'_c)^2 + (f_{bx} / F'_{bx}) * (1 / (1 - f_c / F_{cEx})) = 0.20$$

Check if ≤ 1.0 D/C = 0.20

Use 2x6 Douglas Fir-Larch No. 2 Studs at 16 o.c. at the 1st STORY LEVEL

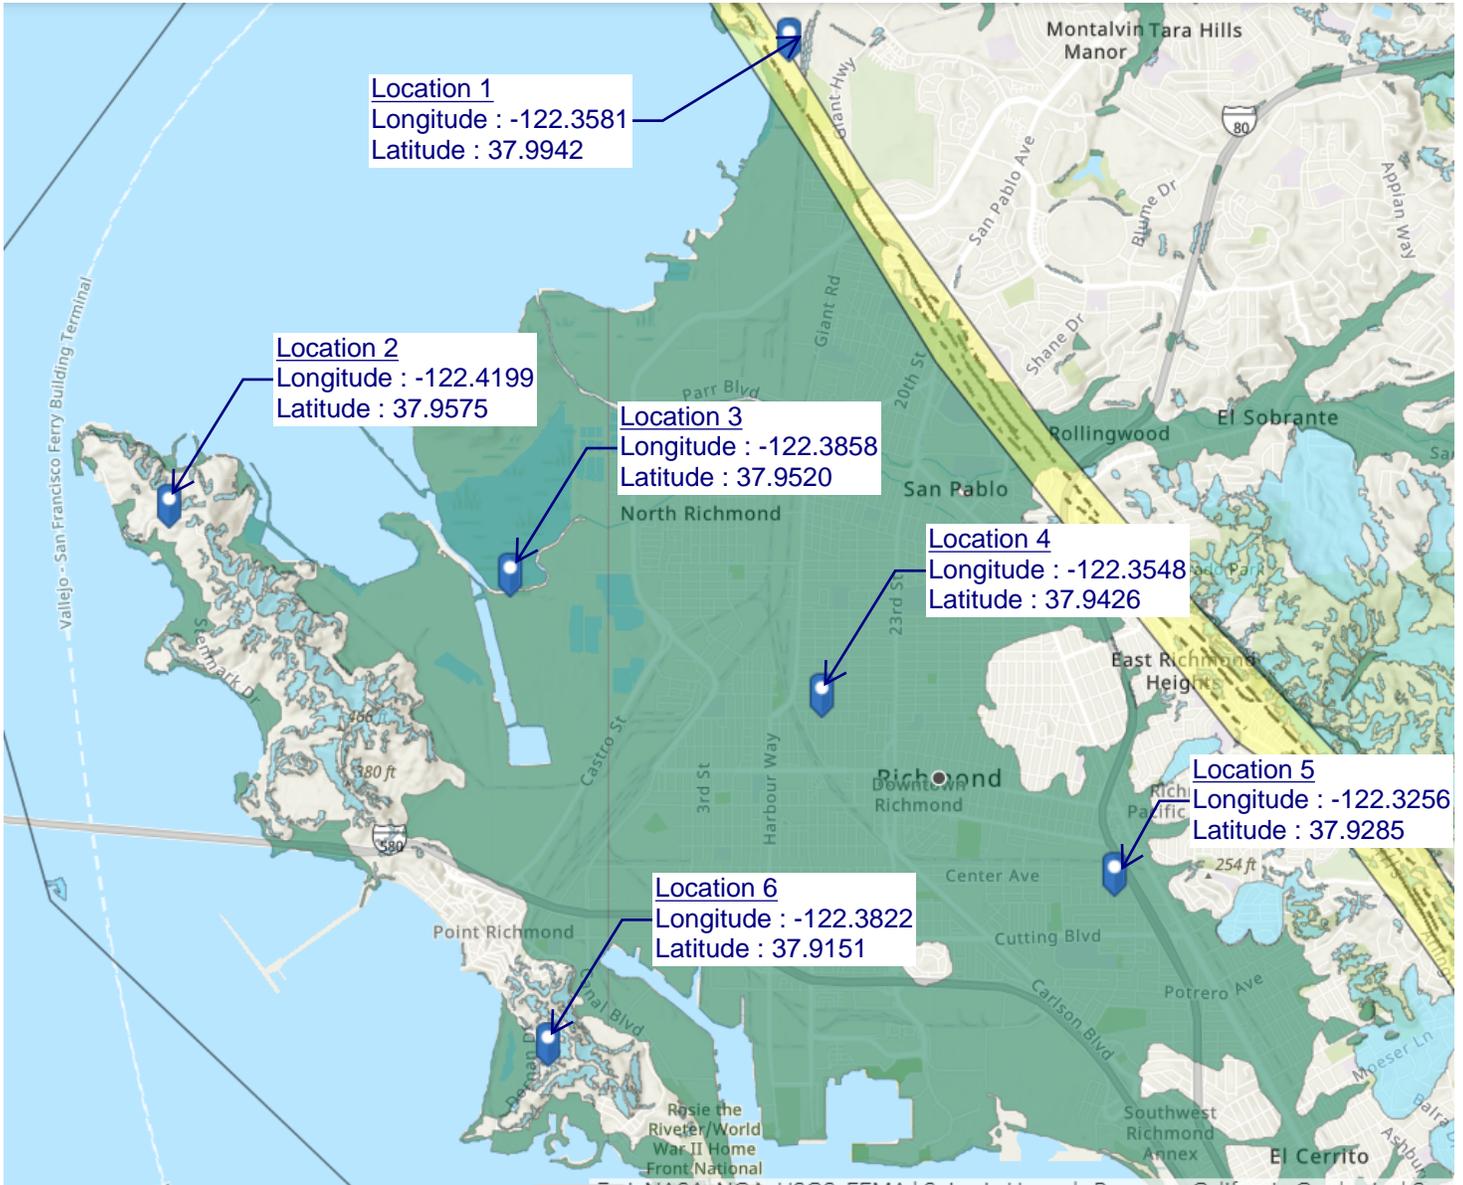

City of Richmond Seismic Map Points

This project provides a calculation package and plans for any home owner in the city of Richmond, CA to build this particular accessory dwelling unit on their land. To allow for versatility in building locations within the city, the seismic parameters of 6 locations were investigated.

Location 1 had the highest seismic design parameters and was used for this project design. See Appendix A for the detailed seismic parameters of all 6 locations.

USGS web services were down for some period of time and as a result this tool wasn't operational, resulting in *timeout* error. USGS web services are now operational so this tool should work as expected.



Richmond , CA - Location 1

Latitude, Longitude: 37.9942, -122.3581



| | |
|---------------------------------------|----------------------------------|
| Date | 7/17/2024, 9:17:10 AM |
| Design Code Reference Document | ASCE7-16 |
| Risk Category | II |
| Site Class | D - Default (See Section 11.4.3) |

Location 1 has the highest seismic design parameters and was used for the lateral design.

| Type | Value | Description |
|-----------------|--------------------------|---|
| S _S | 2.272 | MCE _R ground motion. (for 0.2 second period) |
| S ₁ | 0.877 | MCE _R ground motion. (for 1.0s period) |
| S _{MS} | 2.726 | Site-modified spectral acceleration value |
| S _{M1} | null -See Section 11.4.8 | Site-modified spectral acceleration value |
| S _{DS} | 1.817 | Numeric seismic design value at 0.2 second SA |
| S _{D1} | null -See Section 11.4.8 | Numeric seismic design value at 1.0 second SA |

| Type | Value | Description |
|------------------|--------------------------|---|
| SDC | null -See Section 11.4.8 | Seismic design category |
| F _a | 1.2 | Site amplification factor at 0.2 second |
| F _v | null -See Section 11.4.8 | Site amplification factor at 1.0 second |
| PGA | 0.954 | MCE _G peak ground acceleration |
| F _{PGA} | 1.2 | Site amplification factor at PGA |
| PGA _M | 1.145 | Site modified peak ground acceleration |
| T _L | 8 | Long-period transition period in seconds |
| SsRT | 2.574 | Probabilistic risk-targeted ground motion. (0.2 second) |
| SsUH | 2.882 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration |
| SsD | 2.272 | Factored deterministic acceleration value. (0.2 second) |
| S1RT | 0.984 | Probabilistic risk-targeted ground motion. (1.0 second) |
| S1UH | 1.109 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration. |
| S1D | 0.877 | Factored deterministic acceleration value. (1.0 second) |
| PGAd | 0.954 | Factored deterministic acceleration value. (Peak Ground Acceleration) |

| Type | Value | Description |
|-------------------|-------|--|
| PGA _{UH} | 1.123 | Uniform-hazard (2% probability of exceedance in 50 years) Peak Ground Acceleration |
| C _{RS} | 0.893 | Mapped value of the risk coefficient at short periods |
| C _{R1} | 0.887 | Mapped value of the risk coefficient at a period of 1 s |
| C _V | 1.5 | Vertical coefficient |

| | | | |
|----------------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | Seismic Weight | DATE: | 2025-01-30 |
| LATERAL CALCULATIONS | | BY: | |

SEISMIC WEIGHT

| ROOF LEVEL | WEIGHT (psf) | AREA (ft ²) | TOTAL WT (kip) | |
|---------------|--------------|-------------------------|----------------|-----------------------|
| ROOF | 19 | 610 | 12 | |
| EXTERIOR WALL | 18 | 419 | 8 | |
| INTERIOR WALL | 11 | 203 | 2 | |
| - | 0 | 0 | 0 | |
| - | 0 | 0 | 0 | |
| - | 0 | 0 | 0 | |
| - | 0 | 0 | 0 | |
| TOTAL WEIGHT | | | 21.4 | Net Seismic wt |
| | | | | 35 psf |

| | | | |
|----------------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | Seismic Base Shear | DATE: | 2025-01-30 |
| LATERAL CALCULATIONS | | BY: | |

BUILDING INFORMATION

Number of stories: 1
Building height for lateral calculations: 13.71 ft

SEISMIC DESIGN CRITERIA & RESISTANCE SYSTEM COEFFICIENTS

Design Code: 2021 IBC (ASCE 7-16 Supplement 1, 2 and 3); CBC 2022
Calculation Method: Equivalent Lateral Force Procedure

Risk Factor

All buildings and other structures except those listed in Risk Categories I, III, IV

Risk Category : II Table 1.5-1
Importance Factor, I_e : 1.00 Table 1.5-2

Spectral Acceleration Parameters

| | | |
|---|---------|----------------------|
| Site Class= | D | Default D |
| Spectral Response Acceleration, S_s = | 2.272 g | Mapped Spectral Acc. |
| Spectral Response Acceleration, S_1 = | 0.877 g | Mapped Spectral Acc. |
| Site Coefficient (0.2 Sec Period), F_a = | 1.2 | Table 11.4-1 |
| Site Coefficient (1.0 Sec Period), F_v = | 1.7 | Table 11.4-2 |
| Max Considered EQ Acc., $S_{MS} = F_a S_s$ = | 2.726 g | 11.4-1 |
| Max Considered EQ Acc., $S_{M1} = F_v S_1$ = | 1.491 g | 11.4-2 |
| Design Spectral Acc., $S_{DS} = 2/3 S_{MS}$ = | 1.818 g | short period 11.4-3 |
| Design Spectral Acc., $S_{D1} = 2/3 S_{M1}$ = | 0.994 g | 1 sec period 11.4-4 |
| Seismic Design Category based on S_1 : | E | Section 11.6 |
| Seismic Design Category based on short per.: | D | Table 11.6-1 |
| Seismic Design Category based on 1sec per.: | D | Table 11.6-2 |
| Design Seismic Design Category : | E | Per above or Geotech |

| | | | |
|----------------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | Seismic Base Shear | DATE: | 2025-01-30 |
| LATERAL CALCULATIONS | | BY: | |

SEISMIC DESIGN CRITERIA & RESISTANCE SYSTEM COEFFICIENTS CONTINUED

Seismic Resistance System Coefficients and Factors

System Type: **Bearing wall systems**

System Details: **Light-frame (wood) walls sheathed with wood structural panels rated for shear resistance**

| | | |
|--|-----|--------------|
| Response Modification Coefficient, $R =$ | 6.5 | Table 12.2-1 |
| Overstrength Coefficient, $W_0 =$ | 2.5 | Table 12.2-1 |
| Deflection Amplification Factor, $C_d =$ | 4 | Table 12.2-1 |
| Height Limitations = | 65 | Table 12.2-1 |

Building Period

| | | |
|---|-------------------------------------|---------------------|
| Structure Type : | All other structural systems | Table 12.8-2 |
| Approximate fundamental period, $C_t =$ | 0.02 | Table 12.8-2 |
| Approximate fundamental per. parameter, $x =$ | 0.75 | Table 12.8-2 |
| Building Height from base to highest level, $h_n =$ | 13.71 ft | |
| Building Period, $T = T_a = C_t h_n^x =$ | 0.142 s | 12.8-7 |
| Long Period Transition, $T_L =$ | 12 s | Figure 22-14, p.225 |
| $T_S = S_{D1} / S_{DS} =$ | 0.546838 s | |

Seismic Response Coefficient

| | | |
|---|---------|----------------------------|
| $T \leq 1.5T_S, C_s = S_{DS} / (R / I_e) =$ | 0.280 W | 12.8-2 |
| For $1.5T_S < T \leq T_L, C_s = 1.5 * S_{D1} / (T R / I_e) =$ | N/A | 12.8-3 w/ 11.4.8 Exception |
| For $T > T_L, C_s = 1.5 * S_{D1} T_L / (T^2 R / I_e) =$ | N/A | 12.8-4 w/ 11.4.8 Exception |
| Minimum, $C_{s,min} =$ | 0.080 W | 12.8-5 |
| For $S_1 \geq 0.6g: C_{s,min} = 0.5 S_1 / (R / I_e) =$ | 0.067 W | 12.8-6 |

SEISMIC LOAD

Unfactored Seismic Load, $V = C_s W =$ **0.280 W** Section 12.8-1, 12.4-3

| | | | |
|----------------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | Seismic Base Shear | DATE: | 2025-01-30 |
| LATERAL CALCULATIONS | | BY: | |

Unfactored Vertical Seismic Load Distribution

***Below Force is unfactored and does not include rho**

Seismic Load, $F_x = C_{vx} V$ Section 12.8.3

Story Coefficient, $C_{vx} = (w_x h_x^k) / (\sum w_i h_i^k)$ 12.8-11

Exponent related to structure period, $k = 1.00$ Section 12.8.3

| Level | w_x (k) | h_x (ft) | $w_x h_x^k$ | C_{vx} | $F_x = C_{vx} V$ | $F_x = C_{vx} V S w_x$ |
|---------|-----------|------------|-------------|----------|------------------|------------------------|
| ROOF | 21.40 | 11.35 | 242.89 | 1.000 | 0.280 W | 5.98 k |
| | 0.00 | 0.00 | 0.00 | 0.000 | 0.000 W | 0.00 k |
| | 0.00 | 0.00 | 0.00 | 0.000 | 0.000 W | 0.00 k |
| | 0.00 | 0.00 | 0.00 | 0.000 | 0.000 W | 0.00 k |
| Total = | 21.40 | | 242.89 | 1.000 | 0.280 W | 5.98 k |

Diaphragm Seismic Forces

Diaphragm Design Force, $F_{px} = S F_x w_x / S w_x$ 12.10.1


Maximum Diaphragm Design Force, $F_{px \max} = 0.4 S_{DS} I w_x$ Section 12.10.1

Minimum Diaphragm Design Force, $F_{px \min} = 0.2 S_{DS} I w_x$ Section 12.10.2

| Level | w_x (k) | F_x | F_{px} | $F_{px \max}$ | $F_{px \min}$ | $F_{px \text{ design}}$ |
|-------|-----------|--------|----------|---------------|---------------|-------------------------|
| ROOF | 21.40 k | 5.98 k | 5.98 k | 15.56 k | 7.78 k | 7.78 k |
| | 0.00 k | 0.00 k | 0.00 k | 0.00 k | 0.00 k | 0.00 k |
| | 0.00 k | 0.00 k | 0.00 k | 0.00 k | 0.00 k | 0.00 k |
| | 0.00 k | 0.00 k | 0.00 k | 0.00 k | 0.00 k | 0.00 k |

A

B

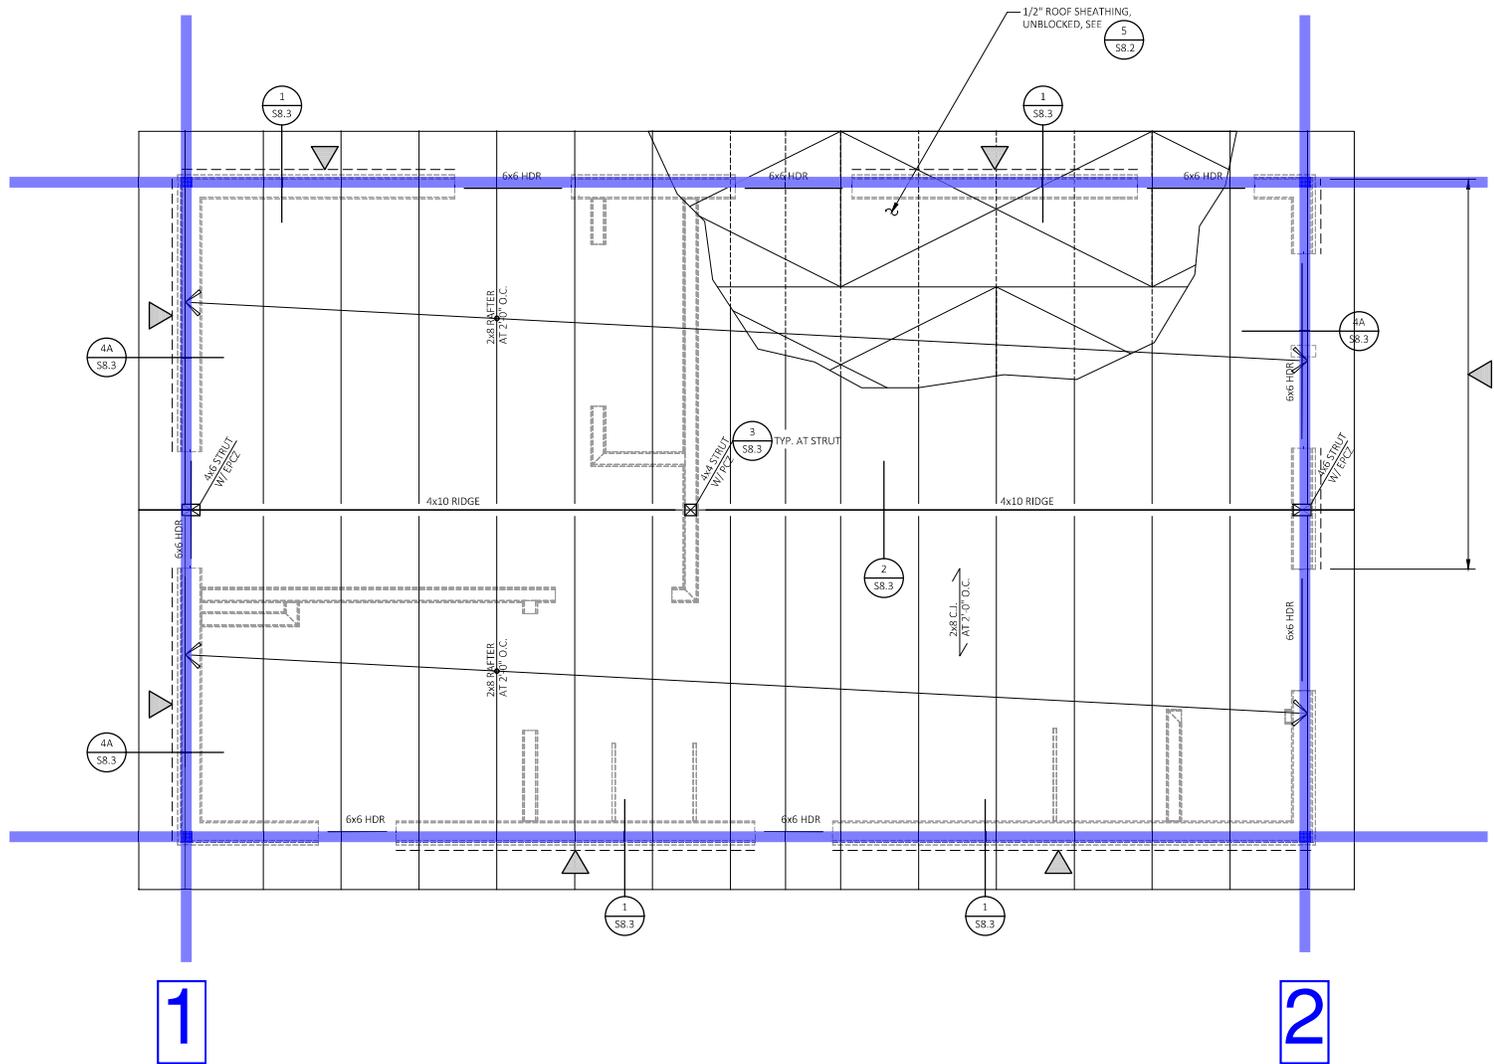

SEISMIC GRIDLINES KEY PLAN

| | | | |
|--------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | ShearWall Design | DATE: | 2025-01-30 |
| | LATERAL CALCULATIONS | BY: | |

SHEARWALL AND UPLIFT CALCULATION NOTES

STORY SHEAR DISTRIBUTION AND SHEAR WALL DESIGN:

Forces distributed by tributary area. See Lateral Key Plan for shear line definition.
See previous lateral calculations for force distribution.

TABLE 1. SHEAR WALL SCHEDULE PER NDS 2021: SPECIAL DESIGN PROVISIONS FOR WIND AND SEISMIC, TABLE 4.3A

| STRUCTURAL 1 | |
|-----------------|--------------|
| ALLOWABLE SHEAR | NAIL SPACING |
| 312 plf | 6 |
| 469 plf | 4 |
| 611 plf | 3 |
| 800 plf | 2 |
| 625 plf | 6DBL |
| 938 plf | 4DBL |
| 1223 plf | 3DBL |
| 1600 plf | 2DBL |

- Nail spacing specified according to capacities in table above unless noted otherwise.
- FACTOR = % tributary width of shear line
- FORCE = Story shear adjusted for tributary width = Story Shear x FACTOR
- For multi-story shear walls, forces from shear lines above will be distributed by tributary area into shear lines below.
- Wall aspect ratio = h/L , has been considered for each shear wall.
- For walls with h/L between 2-3.5, a reduction Factor = $1.25 - 0.125 * h/w$ will be applied to the shear capacity.
- For walls with $h/L > 3.5$, prefabricated shear wall panels will be specified.
- **HF** Denotes Hardy Frame shearwall panel and anchorage will be specified.
- **STRP** Denotes strapped shear wall. See Strapped Shear Wall Calculations for further details.
- **MF** Denotes Moment Frame. See Moment Frame Calculations for further details.
- Tabulated allowable shear value has been multiplied by 0.92 per NDS 2021: SDPWS table 4.3A footnote 10

PROJECT SPECIFIC NOTES:

- Shear walls designed using 15/32" plywood with 10d nail.
- Posts at hold downs will be specified according to manufacturer's recommendation.

| | | | |
|----------------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | ShearWall Design | DATE: | 2025-01-30 |
| LATERAL CALCULATIONS | | BY: | |

SHEARWALL AND UPLIFT CALCULATION NOTES

UPLIFT CALCULATIONS AND TIE-DOWN ANCHORAGE:

TABLE 2. HOLD DOWN SCHEDULE PER SIMPSON CATALOG C-C-2021 (Pg.53)

| ALLOWABLE TENSION LOADS | HOLDOWN TYPE | POST SIZE |
|-------------------------|--------------|-----------|
| 3.075 kip | HDU2 | 4x4 |
| 4.565 kip | HDU4 | 4x4 |
| 5.645 kip | HDU5 | 4x4 |
| 6.97 kip | HDU8 | 4x4 |
| 7.87 kip | HDU8 | 4x6 |
| 9.535 kip | HDU11 | 4x6 |
| 11.175 kip | HDU11 | 4x8 |
| 10.77 kip | HDU14 | 4x6 |
| 14.39 kip | HDU14 | 4x8 |
| 14.445 kip | HDU14 | 6x6 |

TABLE 3. STRAP SCHEDULE PER SIMPSON CATALOG C-C-2021 (Pg. 273)

| ALLOWABLE TENSION LOADS | STRAP TYPE | POST SIZE |
|-------------------------|------------|-----------|
| 4.69 kip | CMSTC16 | 4x4 |
| 1.705 kip | CS16 | 4x4 |

- Tie-downs will be specified according to capacities listed in tables above unless otherwise noted.
- Worst case tie-down anchorage will be specified on plan.
- Designed anchorages may be upsized when specified on plan.
- L' is conservative wall length. Reduction considers tie-downs offset from end of shear wall.
 $L' = L - 1 \text{ ft}$
- Resistant moment from dead loads may not be considered if demand does not exceed minimum hardware capacity.

| | | | |
|--------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | ShearWall Design | DATE: | 2025-01-30 |
| | LATERAL CALCULATIONS | BY: | |

SHEAR WALL DESIGN

UNFACTORED STORY FORCE (F₁): 5.98 K LEVEL: ROOF RHO: 1.0 Design: ASD
 DESIGN STORY FORCE: 4.19 K DIRECTION: EAST - WEST SDS: 1.818

| WALL LINE | AREA (sq ft) | FACTOR | FORCE | TOTAL FORCE | WALL SEGMENT LENGTHS (ft) | | | | | | | Σ WALL LENGTH | DEMAND plf | H/W (MIN.) | REDUCTION | NAIL SPACING | CAPACITY plf | D/C RATIO |
|-------------------|--------------|--------|-------|-------------|---------------------------|------|----|----|----|----|--------------|---------------|------------|------------|-----------|--------------|--------------|-----------|
| | | | | | W1 | W2 | W3 | W4 | W5 | W6 | WALL HT (ft) | | | | | | | |
| A | 0.5 | 0.50 | 2.09 | 2.09 | 6.5 | 7.0 | | | | | 13.50 | 155 | OKAY | 1.00 | 6 | 312 | 0.50 | |
| B | 0.5 | 0.50 | 2.09 | 2.09 | 9.0 | 12.0 | | | | | 21.00 | 100 | OKAY | 1.00 | 6 | 312 | 0.32 | |
| C | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| D | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| E | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| F | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| G | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| H | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| I | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| J | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| K | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| L | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| M | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| N | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| O | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| P | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| Q | | 0.00 | 0.00 | 0.00 | | | | | | | - | - | - | - | - | - | - | |
| TOTAL | 1 | 1.00 | 4.19 | 4.19 | | | | | | | | | | | | | | |
| TOTAL STORY SHEAR | | | | 4.19 | | | | | | | | | | | | | | |

| | | | |
|--------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | ShearWall Design | DATE: | 2025-01-30 |
| | LATERAL CALCULATIONS | BY: | |

SHEAR WALL DESIGN

LEVEL: ROOF
DIRECTION: EAST - WEST

(1) Refer to "Resisting Moment From Dead Load Calculator" for uplift resistance

| HOLD DOWNS | | | | | | | | | |
|---|-------------|---------------------------|-------------|------|--|---------------------------|-----------|------|------|
| Required Tie-Down (Worst Case Wall Segment) | | | | | Required Tie-Down (User Selected Wall Segment) | | | | |
| Wall Line | Wall Length | Uplift (K) ⁽¹⁾ | Tie-Downs | D/C | Wall Length | Uplift (K) ⁽¹⁾ | Tie-Downs | D/C | D/C |
| A | 6.50 | 1.65 | HDU2 W/ 4X4 | 0.54 | | 0.00 | | #N/A | #N/A |
| B | 9.00 | 1.01 | HDU2 W/ 4X4 | 0.33 | | 0.00 | | #N/A | #N/A |
| C | - | - | | - | | - | | - | - |
| D | - | - | | - | | - | | - | - |
| E | - | - | | - | | - | | - | - |
| F | - | - | | - | | - | | - | - |
| G | - | - | | - | | - | | - | - |
| H | - | - | | - | | - | | - | - |
| I | - | - | | - | | - | | - | - |
| J | - | - | | - | | - | | - | - |
| K | - | - | | - | | - | | - | - |
| L | - | - | | - | | - | | - | - |
| M | - | - | | - | | - | | - | - |
| N | - | - | | - | | - | | - | - |
| O | - | - | | - | | - | | - | - |
| P | - | - | | - | | - | | - | - |
| Q | - | - | | - | | - | | - | - |

| | | | |
|--------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | ShearWall Design | DATE: | 2025-01-30 |
| | LATERAL CALCULATIONS | BY: | |

SHEAR WALL DESIGN

UNFACTORED STORY FORCE (Ft): 5.98 K LEVEL: ROOF RHO: 1.0 Design: ASD
DESIGN STORY FORCE: 4.19 K DIRECTION: NORTH-SOUTH SDS: 1.818

| WALL LINE | AREA (sq ft) | FACTOR | FORCE K | TOTAL FORCE | WALL HT (ft) | WALL SEGMENT LENGTHS (ft) | | | | | | Σ WALL LENGTH | DEMAND pif | HW (MIN.) | REDUCTION | NAIL SPACING | CAPACITY pif | D/C RATIO |
|-------------------|--------------|--------|---------|-------------|--------------|---------------------------|-----|----|----|----|-------|---------------|------------|-----------|-----------|--------------|--------------|-----------|
| | | | | | | W1 | W2 | W3 | W4 | W5 | W6 | | | | | | | |
| 1 | 0.5 | 0.50 | 2.09 | 2.09 | 9 | 7.0 | 7.0 | | | | 14.00 | 150 | OKAY | 1.00 | 6 | 312 | 0.48 | |
| 2 | 0.5 | 0.50 | 2.09 | 2.09 | 9 | 3.5 | 3.0 | | | | 6.50 | 322 | REDUCE | 0.88 | 4 | 410 | 0.78 | |
| 3 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 4 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 5 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 6 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 7 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 8 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 9 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 10 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 11 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 12 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 13 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 14 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 15 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 16 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| 17 | | 0.00 | 0.00 | 0.00 | | | | | | | | | | | | | | |
| TOTAL | 1 | 1.00 | 4.19 | 4.19 | | | | | | | | | | | | | | |
| TOTAL STORY SHEAR | | | 4.19 | 4.19 | | | | | | | | | | | | | | |

| | | | |
|--------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | ShearWall Design | DATE: | 2025-01-30 |
| | LATERAL CALCULATIONS | BY: | |

SHEAR WALL DESIGN

LEVEL: ROOF
DIRECTION: NORTH-SOUTH

(1) Refer to "Resisting Moment From Dead Load Calculator" for uplift resistance

| HOLD DOWNS | | | | | | | | | |
|---|-------------|---------------------------|-------------|------|--|---------------------------|-----------|------|------|
| Required Tie-Down (Worst Case Wall Segment) | | | | | Required Tie-Down (User Selected Wall Segment) | | | | |
| Wall Line | Wall Length | Uplift (K) ⁽¹⁾ | Tie-Downs | D/C | Wall Length | Uplift (K) ⁽¹⁾ | Tie-Downs | D/C | D/C |
| 1 | 7.00 | 1.57 | HDU2 W/ 4X4 | 0.51 | | 0.00 | | #N/A | #N/A |
| 2 | 3.00 | 4.35 | HDU4 W/ 4X4 | 0.95 | | 0.00 | | #N/A | #N/A |
| 3 | - | - | | - | | - | | - | - |
| 4 | - | - | | - | | - | | - | - |
| 5 | - | - | | - | | - | | - | - |
| 6 | - | - | | - | | - | | - | - |
| 7 | - | - | | - | | - | | - | - |
| 8 | - | - | | - | | - | | - | - |
| 9 | - | - | | - | | - | | - | - |
| 10 | - | - | | - | | - | | - | - |
| 11 | - | - | | - | | - | | - | - |
| 12 | - | - | | - | | - | | - | - |
| 13 | - | - | | - | | - | | - | - |
| 14 | - | - | | - | | - | | - | - |
| 15 | - | - | | - | | - | | - | - |
| 16 | - | - | | - | | - | | - | - |
| 17 | - | - | | - | | - | | - | - |

| | | | |
|--------------|---|-----------|------------|
| JOB NAME: | One-Bedroom ADU - Spanish Revival Style | JOB NUM.: | 3759 |
| DESCRIPTION: | Diaphragm Design | DATE: | 2025-01-30 |
| | LATERAL CALCULATIONS | BY: | |

DIAPHRAGM DESIGN

LEVEL: ROOF
DIRECTION: E-W
UNFACTORED DIAPHRAGM FORCES: 7.78 K

DIAPHRAGM: 15/32" PLYWOOD W/ 8d NAIL
APPLY ASCE SECTION 12.3.3.4: Y (1.25*STRAP LOAD)
ASD DIAPHRAGM FORCES: 5.45 K

| WALL LINE ID | FACTOR | FORCE K | DIAPHRAGM LENGTH, ft | SHEAR, V plf | BLK'G (Y/N) | CASE 1/3 | NAIL SPACE | V _A plf | D/C | COLLECTOR LENGTH, ft | COLLECTOR FORCE, LBS | REQUIRED STRAP |
|--------------|--------|---------|----------------------|--------------|-------------|----------|------------|--------------------|------|----------------------|----------------------|----------------|
| A | 0.50 | 2.72 | 31.25 | 87 | N | 3 | 6 | 180 | 0.48 | | 0 | CS16 |
| B | 0.50 | 2.72 | 31.25 | 87 | N | 3 | 6 | 180 | 0.48 | | 0 | CS16 |
| C | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| D | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| E | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| F | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| G | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| H | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| I | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| J | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| TOTAL | 1.00 | 5.45 | | | | | | | | | | |

LEVEL: ROOF
DIRECTION: N-S
UNFACTORED DIAPHRAGM FORCES: 7.78 K

DIAPHRAGM: 15/32" PLYWOOD W/ 8d NAIL
APPLY ASCE SECTION 12.3.3.4: Y (1.25*STRAP LOAD)
ASD DIAPHRAGM FORCES: 5.45 K

| WALL LINE ID | FACTOR | FORCE K | DIAPHRAGM LENGTH, ft | SHEAR, V plf | BLK'G (Y/N) | CASE 1/3 | NAIL SPACE | V _A plf | D/C | COLLECTOR LENGTH, ft | COLLECTOR FORCE, LBS | REQUIRED STRAP |
|--------------|--------|---------|----------------------|--------------|-------------|----------|------------|--------------------|------|----------------------|----------------------|----------------|
| 1 | 0.50 | 2.72 | 19.50 | 140 | N | 1 | 6 | 240 | 0.58 | | 0 | CS16 |
| 2 | 0.50 | 2.72 | 19.50 | 140 | N | 1 | 6 | 240 | 0.58 | | 0 | CS16 |
| 3 | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| 4 | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| 5 | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| 6 | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| 7 | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| 8 | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| 9 | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| 10 | | 0.00 | | 0 | | | 6 | 180 | 0.00 | | 0 | CS16 |
| TOTAL | 1.00 | 5.45 | | | | | | | | | | |

Appendix A: Seismic Parameters

USGS web services were down for some period of time and as a result this tool wasn't operational, resulting in *timeout* error. USGS web services are now operational so this tool should work as expected.



Richmond , CA - Location 1

Latitude, Longitude: 37.9942, -122.3581



| | |
|---------------------------------------|----------------------------------|
| Date | 7/17/2024, 9:17:10 AM |
| Design Code Reference Document | ASCE7-16 |
| Risk Category | II |
| Site Class | D - Default (See Section 11.4.3) |

Highest seismic design parameters used for design.

| Type | Value | Description |
|----------|--------------------------|--|
| S_S | 2.272 | MCE_R ground motion. (for 0.2 second period) |
| S_1 | 0.877 | MCE_R ground motion. (for 1.0s period) |
| S_{MS} | 2.726 | Site-modified spectral acceleration value |
| S_{M1} | null -See Section 11.4.8 | Site-modified spectral acceleration value |
| S_{DS} | 1.817 | Numeric seismic design value at 0.2 second SA |
| S_{D1} | null -See Section 11.4.8 | Numeric seismic design value at 1.0 second SA |

| Type | Value | Description |
|-----------|--------------------------|---|
| SDC | null -See Section 11.4.8 | Seismic design category |
| F_a | 1.2 | Site amplification factor at 0.2 second |
| F_v | null -See Section 11.4.8 | Site amplification factor at 1.0 second |
| PGA | 0.954 | MCE_G peak ground acceleration |
| F_{PGA} | 1.2 | Site amplification factor at PGA |
| PGA_M | 1.145 | Site modified peak ground acceleration |
| T_L | 8 | Long-period transition period in seconds |
| $SsRT$ | 2.574 | Probabilistic risk-targeted ground motion. (0.2 second) |
| $SsUH$ | 2.882 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration |
| SsD | 2.272 | Factored deterministic acceleration value. (0.2 second) |
| $S1RT$ | 0.984 | Probabilistic risk-targeted ground motion. (1.0 second) |
| $S1UH$ | 1.109 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration. |
| $S1D$ | 0.877 | Factored deterministic acceleration value. (1.0 second) |
| $PGAd$ | 0.954 | Factored deterministic acceleration value. (Peak Ground Acceleration) |

| Type | Value | Description |
|-------------------|-------|--|
| PGA _{UH} | 1.123 | Uniform-hazard (2% probability of exceedance in 50 years) Peak Ground Acceleration |
| C _{RS} | 0.893 | Mapped value of the risk coefficient at short periods |
| C _{R1} | 0.887 | Mapped value of the risk coefficient at a period of 1 s |
| C _V | 1.5 | Vertical coefficient |

USGS web services were down for some period of time and as a result this tool wasn't operational, resulting in *timeout* error.
 USGS web services are now operational so this tool should work as expected.



Richmond , CA - Location 2

Latitude, Longitude: 37.9575, -122.4199



| | |
|---------------------------------------|----------------------------------|
| Date | 7/17/2024, 9:18:57 AM |
| Design Code Reference Document | ASCE7-16 |
| Risk Category | II |
| Site Class | D - Default (See Section 11.4.3) |

| Type | Value | Description |
|----------|--------------------------|--|
| S_S | 1.579 | MCE_R ground motion. (for 0.2 second period) |
| S_1 | 0.6 | MCE_R ground motion. (for 1.0s period) |
| S_{MS} | 1.895 | Site-modified spectral acceleration value |
| S_{M1} | null -See Section 11.4.8 | Site-modified spectral acceleration value |
| S_{DS} | 1.263 | Numeric seismic design value at 0.2 second SA |
| S_{D1} | null -See Section 11.4.8 | Numeric seismic design value at 1.0 second SA |

| Type | Value | Description |
|-----------|--------------------------|---|
| SDC | null -See Section 11.4.8 | Seismic design category |
| F_a | 1.2 | Site amplification factor at 0.2 second |
| F_v | null -See Section 11.4.8 | Site amplification factor at 1.0 second |
| PGA | 0.665 | MCE_G peak ground acceleration |
| F_{PGA} | 1.2 | Site amplification factor at PGA |
| PGA_M | 0.798 | Site modified peak ground acceleration |
| T_L | 8 | Long-period transition period in seconds |
| $SsRT$ | 1.959 | Probabilistic risk-targeted ground motion. (0.2 second) |
| $SsUH$ | 2.141 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration |
| SsD | 1.579 | Factored deterministic acceleration value. (0.2 second) |
| $S1RT$ | 0.753 | Probabilistic risk-targeted ground motion. (1.0 second) |
| $S1UH$ | 0.833 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration. |
| $S1D$ | 0.6 | Factored deterministic acceleration value. (1.0 second) |
| $PGAd$ | 0.665 | Factored deterministic acceleration value. (Peak Ground Acceleration) |


| Type | Value | Description |
|-------------------|-------|--|
| PGA _{UH} | 0.832 | Uniform-hazard (2% probability of exceedance in 50 years) Peak Ground Acceleration |
| C _{RS} | 0.915 | Mapped value of the risk coefficient at short periods |
| C _{R1} | 0.904 | Mapped value of the risk coefficient at a period of 1 s |
| C _V | 1.416 | Vertical coefficient |

USGS web services were down for some period of time and as a result this tool wasn't operational, resulting in *timeout* error.
 USGS web services are now operational so this tool should work as expected.



Richmond , CA - Location 3

Latitude, Longitude: 37.9520, -122.3858

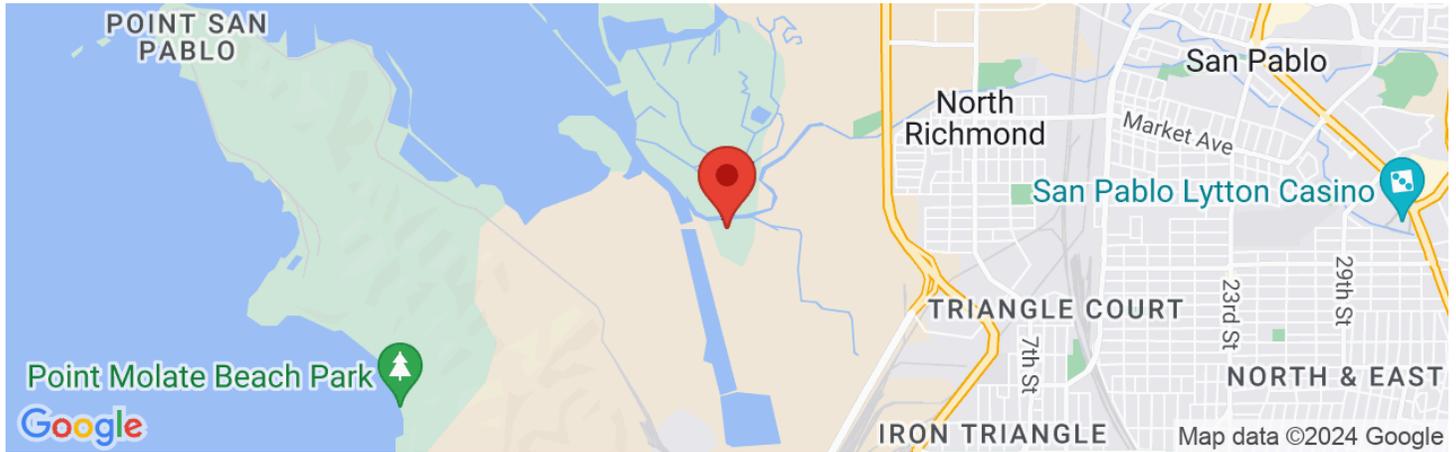

| | |
|---------------------------------------|----------------------------------|
| Date | 7/17/2024, 9:19:54 AM |
| Design Code Reference Document | ASCE7-16 |
| Risk Category | II |
| Site Class | D - Default (See Section 11.4.3) |

| Type | Value | Description |
|----------|--------------------------|--|
| S_S | 1.8 | MCE_R ground motion. (for 0.2 second period) |
| S_1 | 0.685 | MCE_R ground motion. (for 1.0s period) |
| S_{MS} | 2.16 | Site-modified spectral acceleration value |
| S_{M1} | null -See Section 11.4.8 | Site-modified spectral acceleration value |
| S_{DS} | 1.44 | Numeric seismic design value at 0.2 second SA |
| S_{D1} | null -See Section 11.4.8 | Numeric seismic design value at 1.0 second SA |

| Type | Value | Description |
|-----------|--------------------------|---|
| SDC | null -See Section 11.4.8 | Seismic design category |
| F_a | 1.2 | Site amplification factor at 0.2 second |
| F_v | null -See Section 11.4.8 | Site amplification factor at 1.0 second |
| PGA | 0.757 | MCE_G peak ground acceleration |
| F_{PGA} | 1.2 | Site amplification factor at PGA |
| PGA_M | 0.908 | Site modified peak ground acceleration |
| T_L | 8 | Long-period transition period in seconds |
| $SsRT$ | 2.134 | Probabilistic risk-targeted ground motion. (0.2 second) |
| $SsUH$ | 2.352 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration |
| SsD | 1.8 | Factored deterministic acceleration value. (0.2 second) |
| $S1RT$ | 0.817 | Probabilistic risk-targeted ground motion. (1.0 second) |
| $S1UH$ | 0.909 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration. |
| $S1D$ | 0.685 | Factored deterministic acceleration value. (1.0 second) |
| $PGAd$ | 0.757 | Factored deterministic acceleration value. (Peak Ground Acceleration) |

| Type | Value | Description |
|-------------------|-------|--|
| PGA _{UH} | 0.912 | Uniform-hazard (2% probability of exceedance in 50 years) Peak Ground Acceleration |
| C _{RS} | 0.907 | Mapped value of the risk coefficient at short periods |
| C _{R1} | 0.898 | Mapped value of the risk coefficient at a period of 1 s |
| C _V | 1.46 | Vertical coefficient |

USGS web services were down for some period of time and as a result this tool wasn't operational, resulting in *timeout* error.
 USGS web services are now operational so this tool should work as expected.



Richmond , CA - Location 4

Latitude, Longitude: 37.9426, -122.3548



| | |
|---------------------------------------|----------------------------------|
| Date | 7/17/2024, 9:20:37 AM |
| Design Code Reference Document | ASCE7-16 |
| Risk Category | II |
| Site Class | D - Default (See Section 11.4.3) |

| Type | Value | Description |
|----------|--------------------------|--|
| S_S | 1.988 | MCE_R ground motion. (for 0.2 second period) |
| S_1 | 0.762 | MCE_R ground motion. (for 1.0s period) |
| S_{MS} | 2.386 | Site-modified spectral acceleration value |
| S_{M1} | null -See Section 11.4.8 | Site-modified spectral acceleration value |
| S_{DS} | 1.591 | Numeric seismic design value at 0.2 second SA |
| S_{D1} | null -See Section 11.4.8 | Numeric seismic design value at 1.0 second SA |

| Type | Value | Description |
|-----------|--------------------------|---|
| SDC | null -See Section 11.4.8 | Seismic design category |
| F_a | 1.2 | Site amplification factor at 0.2 second |
| F_v | null -See Section 11.4.8 | Site amplification factor at 1.0 second |
| PGA | 0.835 | MCE_G peak ground acceleration |
| F_{PGA} | 1.2 | Site amplification factor at PGA |
| PGA_M | 1.003 | Site modified peak ground acceleration |
| T_L | 8 | Long-period transition period in seconds |
| $SsRT$ | 2.318 | Probabilistic risk-targeted ground motion. (0.2 second) |
| $SsUH$ | 2.571 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration |
| SsD | 1.988 | Factored deterministic acceleration value. (0.2 second) |
| $S1RT$ | 0.886 | Probabilistic risk-targeted ground motion. (1.0 second) |
| $S1UH$ | 0.992 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration. |
| $S1D$ | 0.762 | Factored deterministic acceleration value. (1.0 second) |
| $PGAd$ | 0.835 | Factored deterministic acceleration value. (Peak Ground Acceleration) |

| Type | Value | Description |
|-------------------|-------|--|
| PGA _{UH} | 0.999 | Uniform-hazard (2% probability of exceedance in 50 years) Peak Ground Acceleration |
| C _{RS} | 0.902 | Mapped value of the risk coefficient at short periods |
| C _{R1} | 0.893 | Mapped value of the risk coefficient at a period of 1 s |
| C _V | 1.498 | Vertical coefficient |

USGS web services were down for some period of time and as a result this tool wasn't operational, resulting in *timeout* error.
 USGS web services are now operational so this tool should work as expected.



Richmond , CA - Location 5

Latitude, Longitude: 37.9285, -122.3256



| | |
|---------------------------------------|----------------------------------|
| Date | 7/17/2024, 9:21:16 AM |
| Design Code Reference Document | ASCE7-16 |
| Risk Category | II |
| Site Class | D - Default (See Section 11.4.3) |

| Type | Value | Description |
|----------|--------------------------|--|
| S_S | 2.122 | MCE_R ground motion. (for 0.2 second period) |
| S_1 | 0.817 | MCE_R ground motion. (for 1.0s period) |
| S_{MS} | 2.547 | Site-modified spectral acceleration value |
| S_{M1} | null -See Section 11.4.8 | Site-modified spectral acceleration value |
| S_{DS} | 1.698 | Numeric seismic design value at 0.2 second SA |
| S_{D1} | null -See Section 11.4.8 | Numeric seismic design value at 1.0 second SA |

| Type | Value | Description |
|-----------|--------------------------|---|
| SDC | null -See Section 11.4.8 | Seismic design category |
| F_a | 1.2 | Site amplification factor at 0.2 second |
| F_v | null -See Section 11.4.8 | Site amplification factor at 1.0 second |
| PGA | 0.892 | MCE_G peak ground acceleration |
| F_{PGA} | 1.2 | Site amplification factor at PGA |
| PGA_M | 1.07 | Site modified peak ground acceleration |
| T_L | 8 | Long-period transition period in seconds |
| S_{sRT} | 2.431 | Probabilistic risk-targeted ground motion. (0.2 second) |
| S_{sUH} | 2.699 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration |
| S_{sD} | 2.122 | Factored deterministic acceleration value. (0.2 second) |
| S_{1RT} | 0.925 | Probabilistic risk-targeted ground motion. (1.0 second) |
| S_{1UH} | 1.037 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration. |
| S_{1D} | 0.817 | Factored deterministic acceleration value. (1.0 second) |
| $PGAd$ | 0.892 | Factored deterministic acceleration value. (Peak Ground Acceleration) |


| Type | Value | Description |
|-------------------|-------|--|
| PGA _{UH} | 1.049 | Uniform-hazard (2% probability of exceedance in 50 years) Peak Ground Acceleration |
| C _{RS} | 0.901 | Mapped value of the risk coefficient at short periods |
| C _{R1} | 0.892 | Mapped value of the risk coefficient at a period of 1 s |
| C _V | 1.5 | Vertical coefficient |

USGS web services were down for some period of time and as a result this tool wasn't operational, resulting in *timeout* error.
 USGS web services are now operational so this tool should work as expected.



Richmond , CA - Location 6

Latitude, Longitude: 37.9151, -122.3822

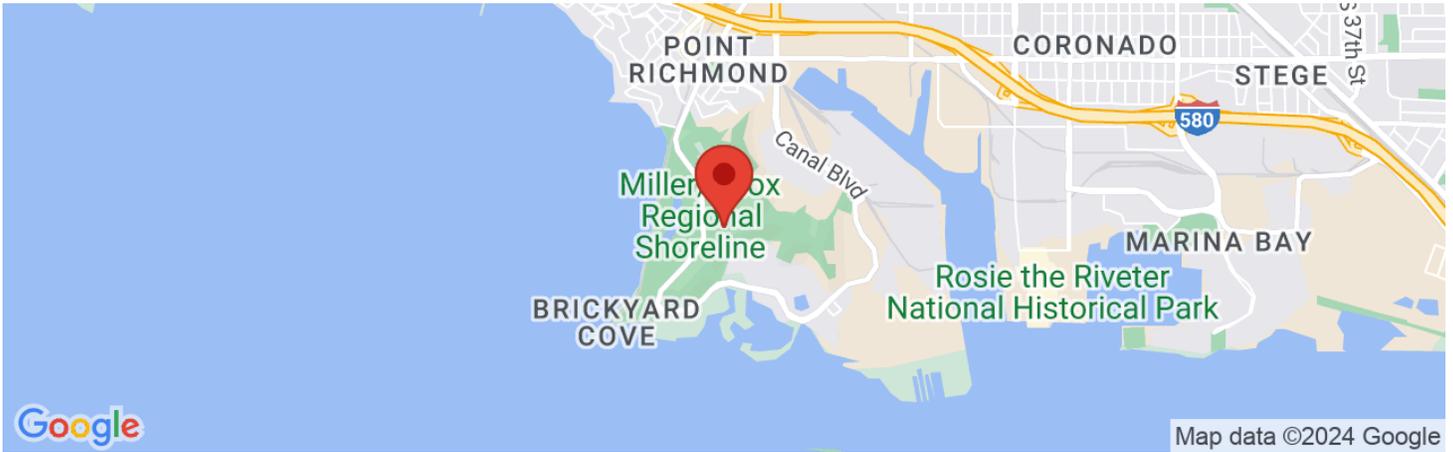

| | |
|---------------------------------------|----------------------------------|
| Date | 7/17/2024, 9:22:14 AM |
| Design Code Reference Document | ASCE7-16 |
| Risk Category | II |
| Site Class | D - Default (See Section 11.4.3) |

| Type | Value | Description |
|----------|--------------------------|--|
| S_S | 1.575 | MCE_R ground motion. (for 0.2 second period) |
| S_1 | 0.6 | MCE_R ground motion. (for 1.0s period) |
| S_{MS} | 1.89 | Site-modified spectral acceleration value |
| S_{M1} | null -See Section 11.4.8 | Site-modified spectral acceleration value |
| S_{DS} | 1.26 | Numeric seismic design value at 0.2 second SA |
| S_{D1} | null -See Section 11.4.8 | Numeric seismic design value at 1.0 second SA |

| Type | Value | Description |
|-----------|--------------------------|---|
| SDC | null -See Section 11.4.8 | Seismic design category |
| F_a | 1.2 | Site amplification factor at 0.2 second |
| F_v | null -See Section 11.4.8 | Site amplification factor at 1.0 second |
| PGA | 0.663 | MCE_G peak ground acceleration |
| F_{PGA} | 1.2 | Site amplification factor at PGA |
| PGA_M | 0.796 | Site modified peak ground acceleration |
| T_L | 8 | Long-period transition period in seconds |
| $SsRT$ | 1.98 | Probabilistic risk-targeted ground motion. (0.2 second) |
| $SsUH$ | 2.156 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration |
| SsD | 1.575 | Factored deterministic acceleration value. (0.2 second) |
| $S1RT$ | 0.755 | Probabilistic risk-targeted ground motion. (1.0 second) |
| $S1UH$ | 0.833 | Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration. |
| $S1D$ | 0.6 | Factored deterministic acceleration value. (1.0 second) |
| $PGAd$ | 0.663 | Factored deterministic acceleration value. (Peak Ground Acceleration) |

| Type | Value | Description |
|-------------------|-------|--|
| PGA _{UH} | 0.839 | Uniform-hazard (2% probability of exceedance in 50 years) Peak Ground Acceleration |
| C _{RS} | 0.918 | Mapped value of the risk coefficient at short periods |
| C _{R1} | 0.907 | Mapped value of the risk coefficient at a period of 1 s |
| C _V | 1.415 | Vertical coefficient |

